### **Globe Valves Actuators**

# **MVE5xx**

#### 

MODEL	FORCE [N]	POWER SUPPLY	DESCRIPTION
MVE504	400		
MVE506	600		long yoke, modulating/
MVE510	1000	24Vac/dc	floating control
MVE515	1500		
MVE504S	400		
MVE506S	600		short yoke, modulating/
MVE510S	1000	24Vac/dc	floating control
MVE515S	1500		



MVE is a flexible electro mechanical actuator for the control of two and three-way globe valves in:

- heating and cooling systems;
- Air Handling Units;
- district heating plants;
- industrial temperature control systems.

The actuator can be controlled either by a proportional (modulating) signal or by an increase/decrease (Floating) signal.

It is easy to mount and connect the actuator. Direct mounting is possible to any CONTROLLI flanged valve. Linkage kits are available for CONTROLLI threaded valves as well as for valves of other manufacturers (table p. 3). The actuator has a fine resolution (500 steps on the full stroke range) for exacting fluid control and it is able to self-calibrate on a different stroke without the need of any user action (this function is DIP switch selectable on the field).

MVE has intelligent behaviour and alarm functionality in case of unexpected operation, feedback of alarms to the user is provided by LEDs (GREEN and RED) on the control board.

N.B.: Do not use the actuator if not coupled with its relating valve.

#### **OPERATION**

The actuator translates the control signal (modulating or 3 point floating) from the controller into a valve position. A modern brushless DC motor in the actuator drive a gear train and a worm gear – screw jack mechanism convert the motor revolutions into accurate and repeatable linear movements.

#### **Control Signal**

MVE can be controlled by one of 2 main control types:

- 3 point floating ;
- Modulating (or proportional) signal with filed selectable range (e.g., 0-10Vdc, 2-10Vdc, 0-5/2-6Vdc, 5-10/6-10Vdc and 4-20mA).

#### **Manual Override**

There is a manual operation handle on the actuator. When it is low-



ered (manual override ON), the power supply to the motor power stage circuitry is cut and the motor stops. The actuator can be operated manually and the valve positioned accordingly.

The manual override lever stays in position until it is raised again, then board and motor will be powered again. At the end of this operation the actuator moves to initial position (on the basis of DIP n. 1 setting) then it follows the control signal. When the manual override is engaged the GREEN and the RED LED are ON.

Manual operation handle can also be used to modify any DIP switch setting or as re-set function after any alarm occurrence.

The actuator is supplied with the manual override lowered (ON). It is not necessary to remove power supply to modify DIP switches setting.

#### **Position Feedback**

The actuator utilizes a 2-10Vdc position feedback (look at DIP n. 1 setting).

#### Calibration

The actuator has both auto and manual stroke calibration, DIP n. 7. In factory delivery the auto stroke calibration is enabled – manual calibration is not necessary unless maintenance is required on the valve or certain alarm functions are desired.

#### End Point Auxiliary Switches (with accessory DMVE)

End point switches change over when the valve is fully open or closed. They are free contacts with 24V AC/DC, 4A max voltage on terminals. End point switches can be utilized to indicate valve stroke end positions and for relay control of additional plant equipment. When the actuators are controlled individually or in sequence, it is possible to use the end switches to toggle when the valve is fully open or fully closed. The auxiliary switch position according to control signal (Y) is shown in the picture below.


Control signal (Y)	Relay KC1	Relay KC2
0-0,5Vdc	KC1 to K2	KC2 to K3
0,5-9,5Vdc	KC1 to K1	KC2 to K3
9,5-10Vdc	KC1 to K1	KC2 to K4



**Controlli S.p.A.** 16010 Sant'Olcese (GE) Tel. 010 73 06 1 Fax. 010 73 06 870/871 www.controlli.eu

The device contains electrical and electronic components and is not allowed to be disposed of as household refuse. All locally valid regulations and requirements must be observed.



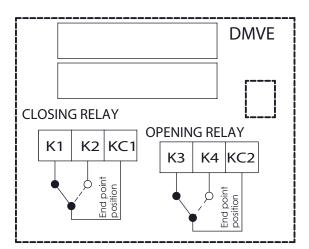

#### Diagnostic

The actuator is provided with a self diagnostic algorithm able to detect faulty conditions:

- stroke calibration out of range 5-60mm; unexpected stall condition (e.g. valve stuck or extra stroke due . to actuator link loose);
- voltage supply out of range. .

These faulty conditions are signalled through the GREEN and RED LED on the electronic board blinking accordingly (see Diagnostic - Alarm Function Table).

	DESCRIPTION	MVE504 MVE504S	MVE506 MVE506S	MVE510 MVE510S	MVE515 MVE515S	
Supply voltage L1 Ln		AC: 24Vac ±20% 50-60Hz DC:22-30Vdc (Reference Ln)				
Power consum	ption (running)	10VA / 4,5W	13VA / 6W	18VA / 8W	21VA / 11W	
Power consum	ption (holding)	8VA / 4W	11VA / 5W	11VA / 5W	13VA / 7W	
			15 s (for valves with st	roke from 5 to 15 mm)		
Pupping time	Modulating		20 s (for valves with str	oke from 15 to 25 mm)		
Running time			30 s (for valves with str	oke from 25 to 60 mm)		
	Floating		60	) s		
Transformer Siz	e [VA]	20	20	30	50	
Stroke			5-60	) mm (limited to 30mm for MV	E.S)	
Force		400 N	600 N	1000 N	1500 N	
Duty cycle			max 50%/e	60 minutes		
Analogue inpu	t Y M	voltage 0-10Vdc -	- impedance > 100kΩ (range 500Ω (rang	: 0-10Vdc, 2-10Vdc, 0-5/2-6Vc ge 4-20mA)	lc, 5-10/6-10Vdc)	
Digital inputs Y	1 Y2	connection to L1 or Ln when powered in AC connection to Ln only when powered in DC				
Output V+		voltage 16Vdc $\pm$ 0,5Vdc; max load 25mA				
Output U		voltage 2-10Vdc (0-100%); max load 2mA				
Number of cyc	cles of manual action	6.000				
Number of cyc	cles of automatic action	100.000				
Type of action		type 1				
Type of mover	nent	linear				
Room tempero	ature	operation -10T55°C; storage -20T55°C				
Room Humidity	/	max 90% R.H.				
Protection deg	ree	Nema 2 (*) / IP54 (**)				
Insulation class						
Printed Circuit Board		FR4 (material) PLC (Performance Level Categories) = 3 PTI (Proof Tracking Index) = 175 - 249V CTI (Comparative Tracking Index) = PTI Pollution Degree = 2				
Standard		Emission/Immunity EMC 2014/30/UE according to EN 61326-1:2013 standard				
Standard(s) for safety		UL 60730-1 A Part 1: General Requirements UL 60730-2-14 Part 2: Particular Requirements for Electric Actuators CAN/CSA-E60730-1:02 Part 1: General Requirements with Amendment 1				
Material		housing: aluminium - cover: ABS plastic				
Colour		aluminium / white				
Weight [kg]		1,7 (MVE5xx); 1,6 (MVE5xxS)				
Date code		yy/ww				

#### **TECHNICAL FEATURES**



06/2020

#### \*To guarantee "Nema Type 2" protection:


- use flexible metal conduit (not supplied);
- Push the listed conduit fitting device (PG13,5 not supplied) over the actuator's cable to butt against the enclosure. Screw in conduit connector. Jacket the actuators input wiring with listed flexible conduit. Properly terminate the conduit in a suitable junction box.

#### \*\*To guarantee IP54 protection


Insert the actuator cable in the PG13,5 cable gland (not supplied)

#### ASSEMBLING

The actuator can be mounted with any orientation but never up-side down. When the fluid temperature exceed 120°C the actuator shall be mounted leaning 45°.

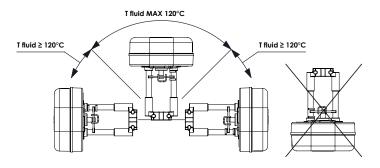

To mount the actuator on to a valve, position the valve stem to the bottom of its travel, slide the actuator onto the valve neck, adjusting with the manual override the screw jack position so the square nut on the valve spindle fits into the groove on the cross bar. Then slide the brace into the groove on the valve neck and secure the nuts.



See mounting instructions for full details (MVE\_DIM223).

#### MAINTENANCE

The actuator is free of maintenance.

#### ACCESSORIES

DMVE	End point auxiliary switches (electrical rate 24V AC/DC, 4A max)
GMVE	Thermal insulation for MVE actuators *
GMVES	Thermal insulation for MVE.S actuators *
KIT-P13.5	10 cable glands kit (nuts and gaskets included)
KIT-T13.5	Kit 10 caps for cable glands hole (nuts and gaskets includ-
	ed)
248	Stem heater (suggested when the fluid temperature is be- low 0°C) *

\* It is not possible to install both thermal insulation (Gxxxx) and stem heaters.

#### **COMPATIBLE VALVES AND ACTUATORS**

CONTROLLI VALVES	MVE5xx	MVE5xxS
Current Controlli valves (except for 2-3TGB.F PN16)	•	-
VSXT09PBP, VSXT10PBP	-	only with MVE504S
2-3TGB.F PN16	-	•
Controlli valves with threaded M40 connections (except for VSB- VMB, VSB.F-VMB.F PN16)	with AG51	-
VSB-VMB, VSB.F-VMB.F PN16	with AG52	with AG63
OTHER MANUFACTURERS VALVES	MVE5xx	MVE5xxS
Belimo H2X-S e H3X-S	with AG82	with AG82
Siemens *	with AG70-10 with AG70-14	-
Danfoss (VR/VF (S) models)	with AG60-07	-
TAC DN15-V298	with AG60-08	-
TAC DN15-V2XX/V3XX	with AG60-09	-
Honeywell **	with AG60-10	-
Airtek	with AG60-11 with AG60-12	-
Johnson Controls VB7816-2111	with AG66	-
Johnson Controls BM-3018-3300	with AG67	-
MUT MK DN50-150	with AG69	-
Tac Venta	•	-

\* AG70-10 for valves having stem Ø 10mm AG70-14 for valves having stem Ø 14mm


\*\* valid for the following models M6: V176A,B, V538C

1/4": V5011A

#### **ELECTRIC CONNECTIONS**

Remove the cover screw with a screwdriver and then remove the cover as shown in the picture beside.

The actuator is equipped with a 8 poles removable terminal block; the each pole of the plug is clearly marked and the same label are reported on the electronic board. Before powering up the actuator make sure the plug is properly connected to the board and the label on the plugs and on the board match.

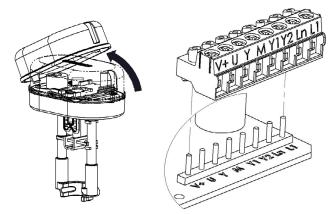

Use PG13,5 cable gland (not supplied).



V+	U	Y	Μ	Y1	Y2	Ln	L1
▼	L /						
<u>L1</u>	/ Lr	١			-		

Label	Description	Function	Cable type	Max wire length	
LI	24 Vac/dc	Power	AWG 16 (min 1mm² -	75m	
Ln	0V	supply	max 1,5mm²)	75111	
Y	0-10 Vdc	Modulating control	AWG 20 (min 0,5mm² -	200m	
м	0V (common)	input	$\max 1,5 \text{mm}^2$	Zoom	
Y١	Open	Floating	AWG 20 (min 0,5mm <sup>2</sup> -	200m	
Y2	Close	input	(min 0,3mm - max 1,5mm²)	20011	
V+	16 Vdc	Voltage	AWG 20 (min 0,5mm² -	200m	
м	0V (common)	output max 25mA	$(\min 0, 5\min^2 - \max 1, 5\min^2)$	200111	
U	2-10 Vdc	Feedback		200	
м	0V (common)	output signal	(min 0,5mm² - max 1,5mm²)	200m	

Note: To avoid damages to electronic components caused by the PCB bending, do not press too much while fixing the terminal block.

## Matching between MVE terminal block and others Controlli actuators

1	2	3	4	5
L1	L2	М	V+	Y
G	G0	MX	G1	X1
L1	LN	м	V+	Y
$\square$		$\square$		

SH500


MVB5-MVL5-MDL5

MVF-MVH5-MVL5-F


MVE

#### WIRING DIAGRAMS


#### 3 point floating control (sink connection)

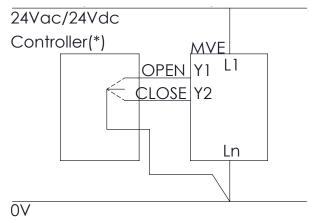

#### 3 point floating control (source connection)

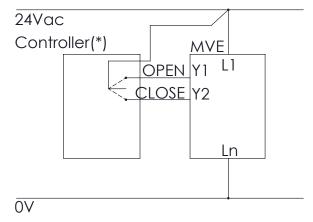

#### Modulating control (0-10Vcc)

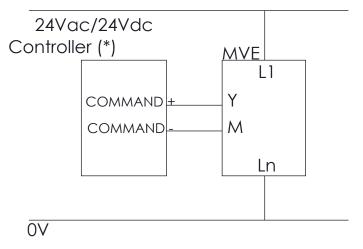


#### N.B.: M and Ln signals are internally connected.

(\*) MVE contain a single half-wave rectifier power supply. They must not be powered with transformers that are used to power other devices using not isolated double half-wave rectifier power supply.



Set the DIP switches according to the tables here below. Power down and power up again the actuator or act on the manual override to be sure that settings will be recognized.

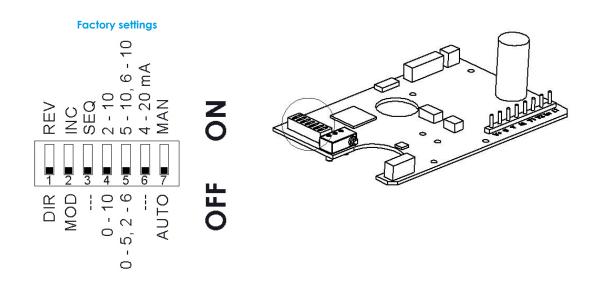

DIP switch	OFF	ON
1	U = feedback $U = 10V$	U= feedback
2	Modulating Control (MOD) (Input between Y [+] and M [-])	3 point floating (INC) (Y1 open-extend, Y2 close-retract connected L1 or Ln if powered in Vac; if powered in Vdc connected necessarily to Ln )
3	-	Selection of sequence mode, control range defined by DIP n. 5
4	Modulating Control 0-10Vdc (DIP n. 2 OFF only)	Modulating Control 2-10Vdc (DIP n. 2 OFF only)
5	Sequence Control 0-5Vdc with DIP n. 4 OFF only Sequence Control 2-6Vdc with DIP n. 4 ON only (DIP n. 3 ON only)	Sequence Control 5-10Vdc with DIP n. 4 OFF only Sequence Control 6-10Vdc with DIP n. 4 ON only (DIP n. 3 ON only)
6	Voltage Input Signal (input between Y [+] and M [-])	Current Input Signal 4-20mA (input between Y [+] and M [-]). In this case DIP n. 4 must be set to ON.
7	Automatic Calibration: the actuator updates the stroke range every time an unexpected mechanical stop is detected for at least 10s	Manual Calibration: the actuator calibration is started moving the DIP from OFF to ON or vice versa. With DIP in ON in case of extra stroke or if an unexpected endpoint is detected, the actuator will never update the stroke



#### **DIAGNOSTIC - ALARM FUNCTIONS**


N°	LEDs behaviour	Error	Actuator use	Actuator	behaviour	Typical trouble shooting condition	Reset procedure
				Automatic calibration (DIP N. 7 OFF)	Manual calibration (DIP N. 7 ON)		
1	RED ON	Valve stroke less than 5mm	Calibration/ first installation	The actuator pushes/pulls 2 times (unexpected stall) trying to remove the possible obstacle. After 2 tries an alarm is signalled and the actuator moves to initial position and does not respond to control signal. Stroke value is not updated because out of range	The actuator pushes/pulls 2 times against endpoint during calibration and the actuator moves to the initial position and then it does not respond to the control signal. The actuator keeps the previous stroke	Valve with a stroke length lower than 5mm	Remove power and power up again
2	RED quick blinking + GREEN ON	Stroke longer than 60mm	Calibration/ first installation	The actuator exits the 60mm stroke range and it moves toward the new stroke limit signalling an anomaly. The actuator pushes/pulls 2 times against the new stroke limit, then it goes back to the initial position still signalling the anomaly until it is not within 60mm. The actuator does not calibrate the stroke after 10s (wrong range)	The actuator exits the 60mm stroke range and it moves toward the new stroke limit signalling an anomaly. The actuator pushes/pulls 2 times against the new stroke limit, then it goes back to the initial position still signalling the anomaly until it is not within 60mm. The actuator does not calibrate the stroke after 10s (wrong range)	Valve with a stroke length longer than 60mm	Remove power and power up again
3	RED Quick Blinking	Unexpected stall within the calibrated stroke range	normal operation	The actuator tries 5 times against the new stall condition and then after 10s the actuator updates the new stroke length	The actuator tries 5 times against the new stall condition. At the end of the attempts the fault will be signalled. The actuator does not update the new stroke length, but after 60s makes other attempts to verify the stall condition	Valve stuck	Inverted control signal
4	RED Quick Blinking	Stroke longer than expected	Normal operation	The actuator moves toward the new stall condition with a lower speed; after 10s the actuator updates the new stroke value	The actuator moves toward the new stall condition with a lower speed; after 10s the actuator does not update the new stroke value	Stem connection loose or valve damaged	Inverted control signal
5	RED slow Blinking	Low Power Voltage	Normal operation	The actuator is still working but performance cannot be	The actuator is still working but performance cannot be	1. Wrong transformer size	Correct Voltage Power
	_			guaranteed	guaranteed	2. Unstable power	i uwei
6	RED slow Blinking	High Power Voltage	Normal operation	The actuator is still working but performance cannot be guaranteed	The actuator is still working but performance cannot be guaranteed	1. Wrong transformer size	Correct Voltage Power
					0	2. Unstable power	10000





#### **STANDARD LEDs BEHAVIOUR**

N°	LED behaviour Actuator status			
1	GREEN ON	The actuator arrived at the extreme point of the stroke read		
2	GREEN BLINKING The actuator arrived at the intermediate point of the stroke read			
3	RED GREEN BLINKING The actuator is reading the stroke or it is going to initial position			
4	RED GREEN ON	Manual control ON, the actuators ignores the control signal. ATTENTION! The electronic board is electrically supplied		

#### DIMENSIONS [mm]

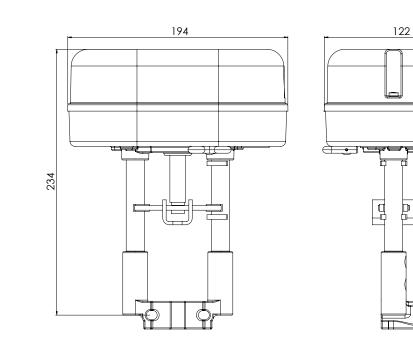





86

The performances stated in this sheet can be modified without any prior notice

